


NOTE: ALL TUBE STATIONS REQUIRE SOFTWARE VERSION 2.00.01 OR LATER

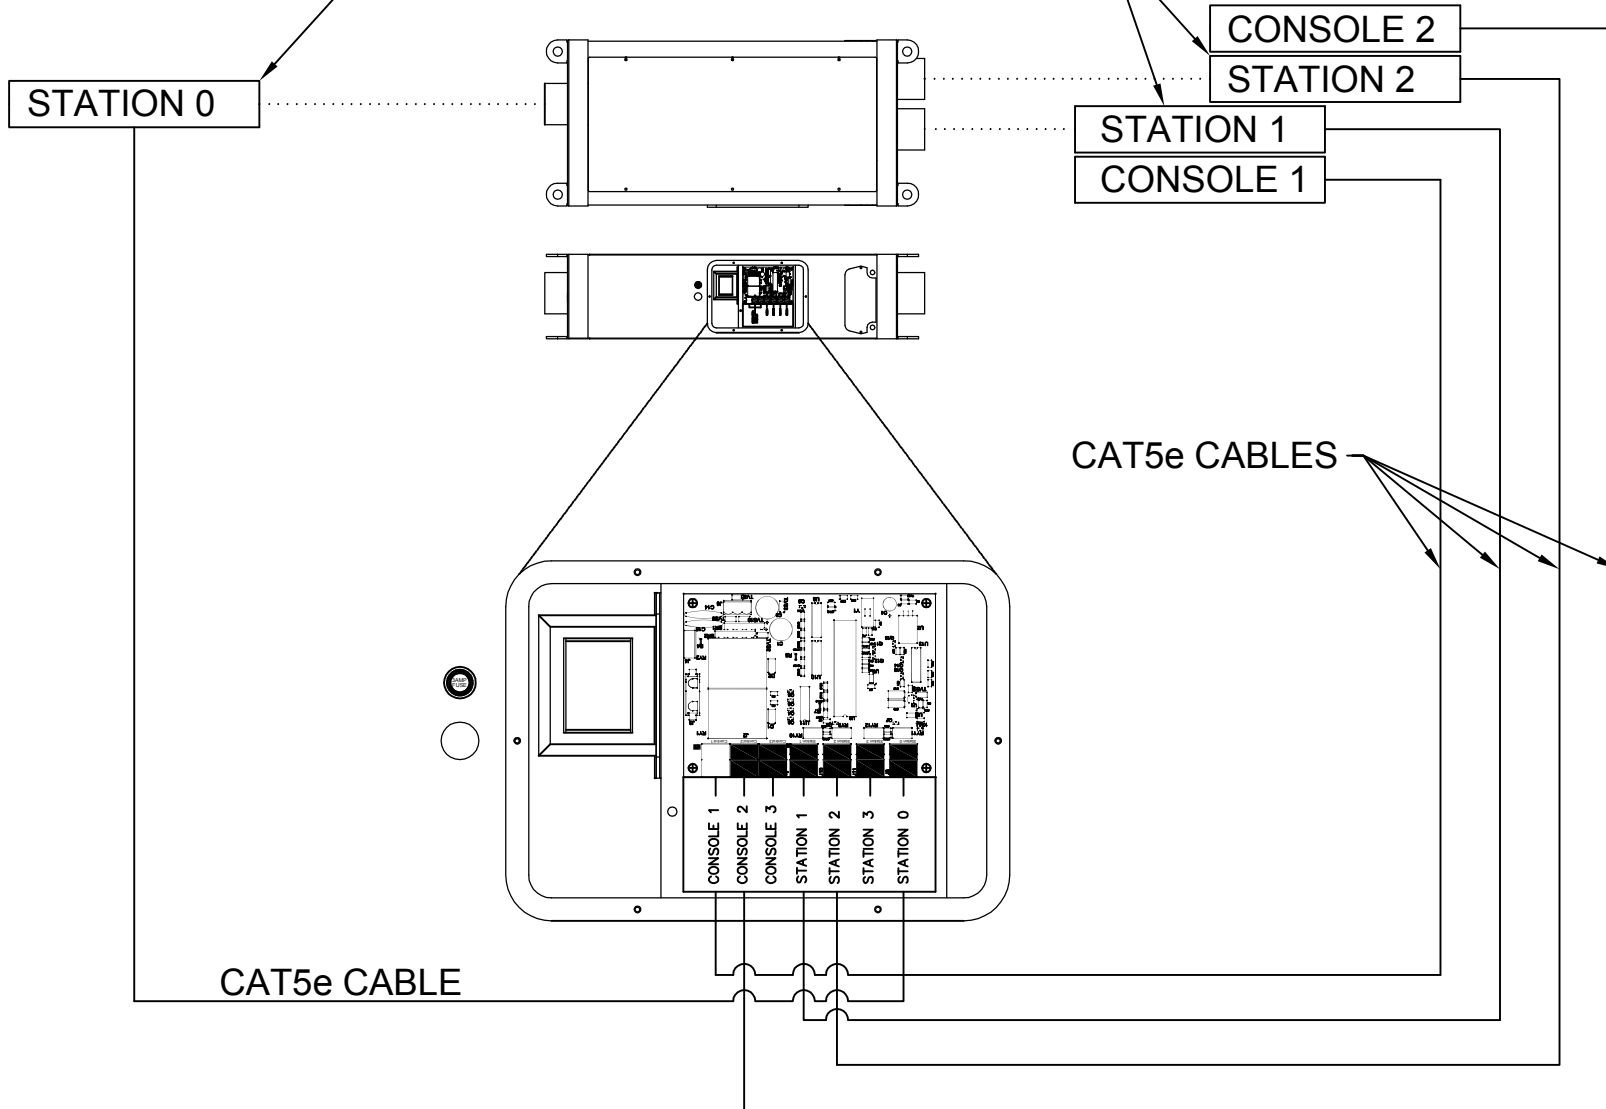

NOTES:

TYPICAL INSTALLATION
 STATION 0 = CUSTOMER UNIT
 STATION 1 = TELLER STATION 1
 STATION 2 = TELLER STATION 2
 ALL STATIONS MUST HAVE I/O CONTROL BOARDS

IF SYSTEM COMBINES A MANUAL TELLER STATION WITH A MOTORIZED TELLER STATION, THE MANUAL TELLER STATION WILL REQUIRE AN I/O CONTROL BOARD.

HAMILTON AIR

**4-1/2" TUBE DIVERTER UNIT
 WIRING DETAIL**

THESE DRAWINGS ARE THE PROPERTY OF HAMILTON AIR CO. AND SHALL NOT BE REPRODUCED OR COPIED OR USED AS THE BASIS FOR MANUFACTURE OR SALE OF APPARATUS WITHOUT PERMISSION

REV.-1	DATE:	--
REV.-2	DATE:	--
REV.-3	DATE:	--